

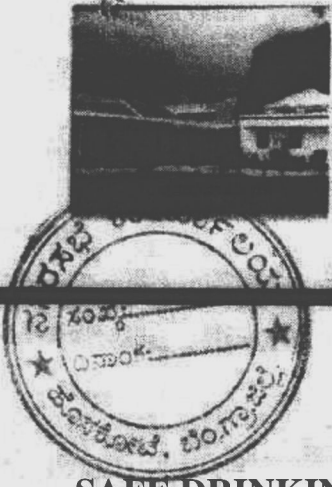
ದೂರವಾಣಿ: 7931221, ಸಹಾಯವಾಣಿ: 7931759

ಇ-ಮೇಲ್: itstaff_ulb_hosakote@yahoo.com

ವೆಬ್‌ಸೈಟ್: www.hosakotetown.gov.in

“ಸ್ವಚ್ಛ ಭಾರತ, ಸ್ವಚ್ಛ ಹೊಸಕೋಟೆ” ನಗರಸಭಾ ಕಾರ್ಯಾಲಯ

ಹೊಸಕೋಟೆ-562 114, ಬೆಂಗಳೂರು ಗ್ರಾಮಾಂತರ ಜಿಲ್ಲೆ.





Dated: 27/05/2024

CERTIFICATE

SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

It is certified that an inspection team headed by K. Nagaraja from CMC, Hosakote PHED inspected the Sri Vivekananda Vidya Kendra, Sri Ramakrishna Road, Sir M.Vishveshwaraiah Extension, Hosakote, Bengaluru Rural District, Karnataka on 27/05/2024 and on the basis of Water Test Report (Attached) bearing no BTQL/2024/05/0106 dated 25/05/2024 of Bharat Quality testing Lab (PHED Lab) certified that the Sri Vivekananda Vidya Kendra has safe drinking water facilities for the students and members of staff of the institution. School is also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt. This certificate is issued after checking the water test report of the authorized Lab.

This certificate is valid till 26/05/2025.


Commissioner
CMC, Hosakote


To,

Sri Vivekananda Vidya Kendra,

Sri Ramakrishna Road,

Sir M.Vishveshwaraiah Extension,

Hosakote, Bengaluru Rural District, Karnataka



Bharat Quality Testing Lab

An ISO 9001-2015 Certified Laboratory

#3738, 1st Main Road, Gayathrinagar, Bangalore – 560021

Phone: 080-299025094 Mob. : 9071286611, 9035662508,

Email – bqtlab@gmail.com Website-www.bqtlab.com



TEST REPORT

Report No. : BQTL/2024/05/0106	Report Date : 25.05.2024
M/S. Swamy Vivekananda Vidya Kendra Sree Ramakrishna Road Sir, M.V, Badavane Hoskote-562 114 Bangalore Rural	Customer Reference : Verbal
Sample received by : Custmer	Date of Receipt : 22.05.2024
Sample Nature : Drinking Water (RO)	Date of test Start : 22.05.2024
	Date of Completion of Test: 25.05 2024
	Sample Job Number : BQTL/2023/0106
	Sample Particulars : Water

Sample Description: Colourless Odorless Transparent Liquid

			Maximum Acceptable Limits	Maximum Permissible Limits	
1	Colour, Hazen Units	<5	5	15	IS 3025/Part-4
2	Odour	Agreeable	Agreeable	Agreeable	IS 3025/Part-5
3	pH Value	7.06	6.5 – 8.5	No Relaxation	IS 3025/Part-11
4	Turbidity as NTU	<1	1	5	IS 3025/Part-10
5	Total Hardness as CaCO ₃ , mg/L	12.0	200	600	IS 3025/Part-21
6	Calcium as Ca, mg/L	3.2	75	200	IS 3025/Part-40
7	Magnesium as Mg, mg/L	0.96	30	100	IS 3025/Part-46
8	Total Dissolved Solids, mg/L	45.0	500	2000	IS 3025/Part-16
9	Chloride as Cl, mg/L	21.6	250	1000	IS 3025/Part-32
10	Sulphate as SO ₄ , mg/L	<0.1	200	400	IS 3025/Part-24
11	Nitrate as NO ₃ , mg/L	<0.1	45	No Relaxation	IS 3025/Part-34
12	Iron as Fe, mg/L	<0.1	0.3	1	IS 3025/Part-53
13	Fluoride as F, mg/L	<0.1	1.0	1.5	IS 3025/Part-60
14	Zinc as Zn, mg/L	<0.1	5	15	IS 3025/Part-49
15	Chromium as Cr ⁶⁺	<0.01	0.05	No Relaxation	IS 3025/Part-52
16	Copper as Cu, mg/L	<0.01	0.05	1.5	IS 3025/Part-42
17	Aluminium as Al, mg/L	<0.01	0.03	0.2	IS 3025/Part-55
18	Boron as B, mg/L	<0.1	0.5	1.0	IS 3025/Part-57
19	Manganese as Mn, mg/L	<0.1	0.1	0.3	IS 3025/Part-59
20	Total Alkalinity as CaCO ₃ , mg/L	17.2	200	600	IS 3025/Part-23

Microbiological Test

Tests	Results	Limits as Per IS 10500-2012	Protocol
Total Coliform/100ml	Absent	Not detectable	IS 1622

Remarks:

Chemical –Above tested sample meets to Acceptable limits as per IS 10500: 2012, with respect to above parameters

Microbiology–Tested Sample Conforms to IS 10500 with respect to the above parameter.

Tested by



J. N. Nalini
Authorized Signatory

Note

- 1 – The results listed above pertain only to the tested samples and applicable parameters.
- 2 – Samples will be stored for a period of 15 days unless otherwise specified.
- 3 – This report is not to be reproduced either wholly or in part and cannot be used as an evidence in the court of law and should not be used in any advertising media without prior written permission.
- 4 – Sampling not done by us unless specified.